



INSTALLATION, MAINTENANCE AND OPERATING INSTRUCTIONS RuB Side Tap and Cap

BONOMI INDUSTRIES s.r.l.
an ISO 9001 Company






IMO045.04

Approved by




IMO045.04

Depressurize the line before disassembling the side tap / cap
Сбросить давление в линии перед демонтажем спускного крана / пробки

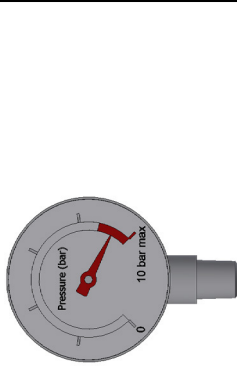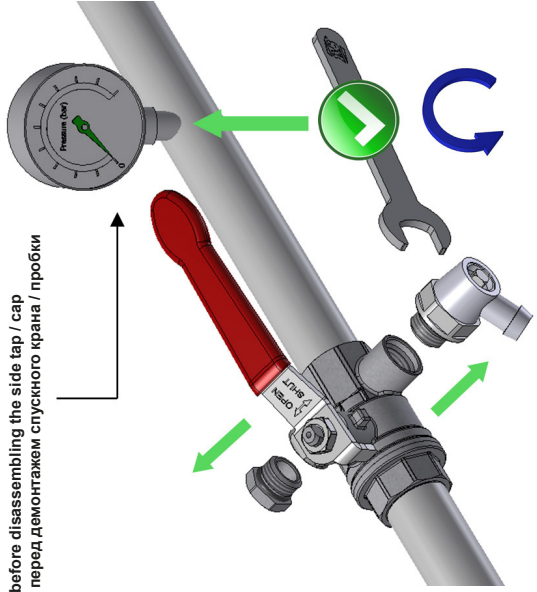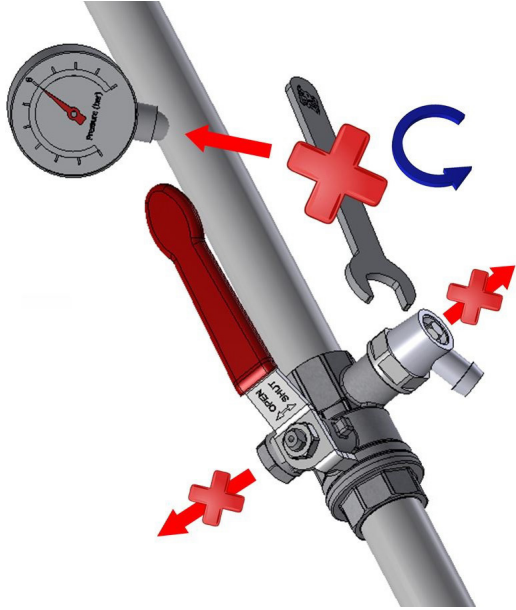

Side tap operating pressure: 10 bar Max
Максимальное применяемое давление спускного крана: 10 бар



BONOMI INDUSTRIES SRL - Italy
Via Padana Superiore 29 - 25080 Mazzano (BS)
Tel: (+39) 030 212441 - Fax(+39) 030 2629498
sales@rubvalves.com - www.rubvalves.com

Side tap operating temperature: 110°C Max
Максимально применяемая температура спускного крана: 110°C



The company reserves all rights for the information contained herein. Any undated reference to a code or standard shall be interpreted as referring to the latest edition. Products/documents may be changed at any time without notice. Copyright **BONOMI INDUSTRIES s.r.l.**, February 2026. All rights reserved. Printed on recyclable paper. For complete disclaimer: www.rubvalves.com/disclaimer